

INDEX
SERIES 600 SWING CHECK VALVE



	PAGE
INTRODUCTION AND HISTORY	7C-2
FEATURES AND BENEFITS	7C-3
SPECIFICATIONS	7C-3
ORDERING	
Dimensions:	
Standard	7C-4
Lever and Weight	7C-5
Lever and Spring	7C-6
Optional Tap Locations	7C-7
Weights	7C-8
Submittal Sheet	7C-9
INSTALLATION AND MAINTENANCE	7C-10
REPAIRS	
Parts Lists:	
Standard	7C-11
Lever and Weight	7C-12
Lever and Spring	7C-13



WATEROUS SERIES 600 SWING CHECK VALVE

American Flow Control's Waterous Series 600 Swing Check Valves are in full compliance with ANSI/AWWA C508. Configurations are available that are Listed by Underwriters Laboratories, Inc. and Approved by Factory Mutual Research.

Rated working pressure is 175 p.s.i.g. These check valves are suitable for horizontal installation or in a vertical installation when the flow of water is in an upward direction.

Waterous Series 600 swing check valves feature a sturdy iron body and bronze mounted construction. This design provides extensive use of corrosion resistant materials in places where corrosion may be a problem.

SERIES 600 – FEATURES AND BENEFITS



FEATURES AND BENEFITS

American Flow Control's Waterous Series 600 Swing Check Valves are in full compliance with ANSI/AWWA C508. Configurations are available that are Listed by Underwriters Laboratories, Inc. and Approved by Factory Mutual Research.

Rated working pressure is 175 p.s.i.g. These check valves are suitable for horizontal installation or in a vertical installation when the flow of water is in an upward direction.

Waterous Series 600 swing check valves feature a sturdy iron body and bronze mounted construction. This design provides extensive use of corrosion resistant materials in places where corrosion may be a problem.

RESILIENT SEATED DISC

The disc is constructed of high-strength bronze with a rubber seal recessed into the disc to assure a positive seal even under low flows.

Series 600 swing check valves are available in sizes 3" through 12" and are available with lever and spring or lever and weight for applications where rapid flow reversals may be encountered.

CORROSION RESISTANT

The clapper arm is made of high-strength bronze. The check valve disc and clapper arm assembly uses corrosion resistant bearings, bushings and washers to reduce wear and assure long operating life.

FULL WATERWAY

These check valves are designed to provide a "Full Waterway" per MSS SP-71, Type I. Swing check valves with Full Waterway, when fully open, have waterway cross-sectional area at any point, that is at least equal to the area of a circle whose diameter is the nominal valve size.

American Flow Control **Waterous Series 600 Swing Check Valves** have these standard features:

- Comply with ANSI/AWWA C508
- Stainless Steel Clapper Arm Shaft
- Full Waterway per Type I of MSS SP-71
- Bronze Clapper Arm
- Resilient Seated Disc
- UL/FM Valves Available

SPECIFICATIONS

Swing check valves shall be Waterous Series 600 as manufactured by American Flow Control. Check valves shall be manufactured from gray iron meeting or exceeding ASTM A126, Grade B. Check valves shall comply with ANSI/AWWA C508, latest revision and include the following features:

Check valves shall be designed with full waterway opening per Type I of MSS SP-71.

Check valve disc and clapper arm assembly shall be removable from the check valve body without having to remove the check valve from the pipeline.

Disassembly of valve internals shall require no special tools other than standard socket wrenches.

Check valve disc and clapper arm assembly shall be assembled using corrosion resistant bearings, bushings and washers to reduce wear and increase service life.

Clapper arm shall be constructed of high-strength manganese bronze. Clapper arm shaft shall be stainless steel.



Disc shall be constructed of manganese bronze with a Nitrile rubber seal recessed into the disc face to provide a positive seal against the mating bronze body seat ring.

In applications where slam surge may occur, check valves can be furnished or retrofitted with outside lever and weight or spring.



SERIES 600 – STANDARD DIMENSIONS

SERIES 600 – STANDARD DIMENSIONS

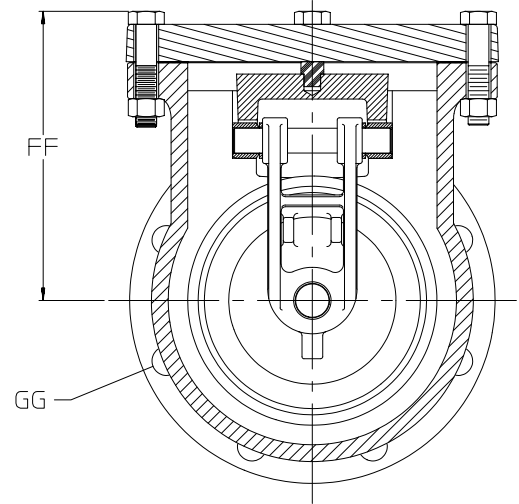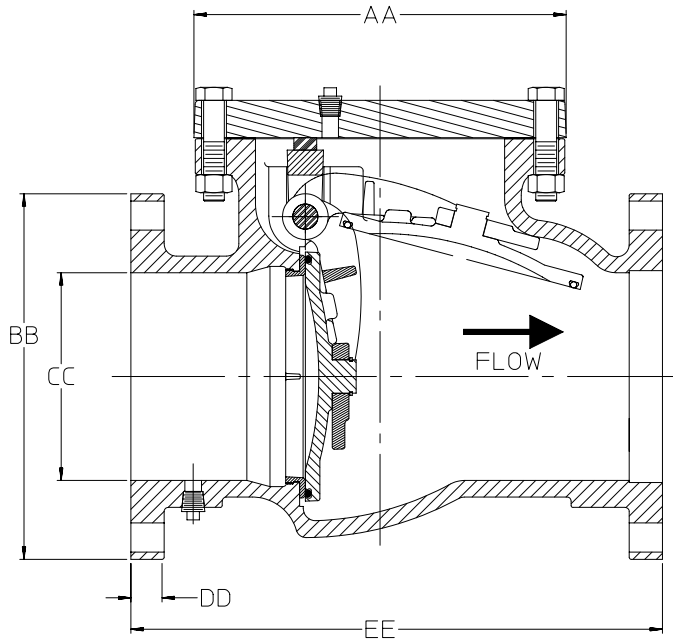


IL1456

Valve Size	AA	BB	CC	DD	EE	FF	GG		
							Holes	Size	Bolt Circle
3"	8.50	7.50	3.12	0.75	11.00	7.12	4	0.75	6.00
4"	8.38	9.00	4.12	0.94	13.00	6.81	8	0.75	7.50
6"	11.12	11.00	6.25	1.00	16.00	8.50	8	0.88	9.50
8"	14.00	13.50	8.12	1.12	19.50	10.19	8	0.88	11.75
10"	15.25	16.00	10.12	1.19	22.00	12.00	12	1.00	14.25
12"	18.00	19.00	12.12	1.25	26.00	12.38	12	1.00	17.00

SERIES 600 – LEVER AND WEIGHT DIMENSIONS




SERIES 600 - LEVER AND WEIGHT DIMENSIONS

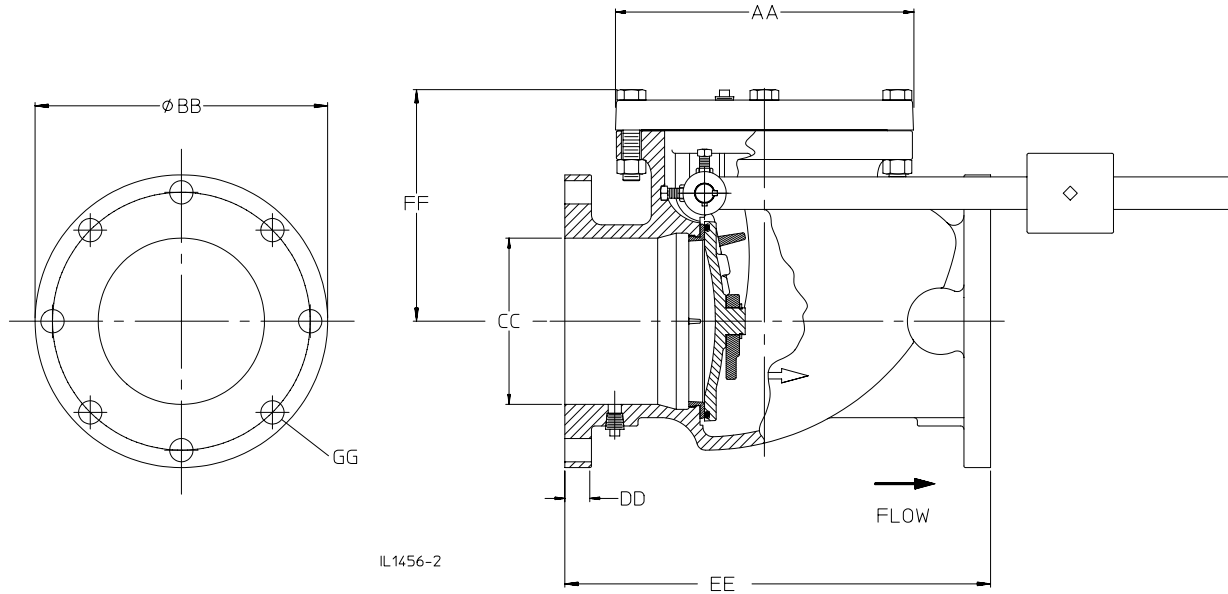

Valve Size	AA	BB	CC	DD	EE	FF	GG		
							Holes	Size	Bolt Circle
3"	8.50	7.50	3.12	0.75	11.00	7.12	4	0.75	6.00
4"	8.38	9.00	4.12	0.94	13.00	6.81	8	0.75	7.50
6"	11.12	11.00	6.25	1.00	16.00	8.50	8	0.88	9.50
8"	14.00	13.50	8.12	1.12	19.50	10.19	8	0.88	11.75
10"	15.25	16.00	10.12	1.19	22.00	12.00	12	1.00	14.25
12"	18.00	19.00	12.12	1.25	26.00	12.38	12	1.00	17.00





SERIES 600 – LEVER AND SPRING DIMENSIONS

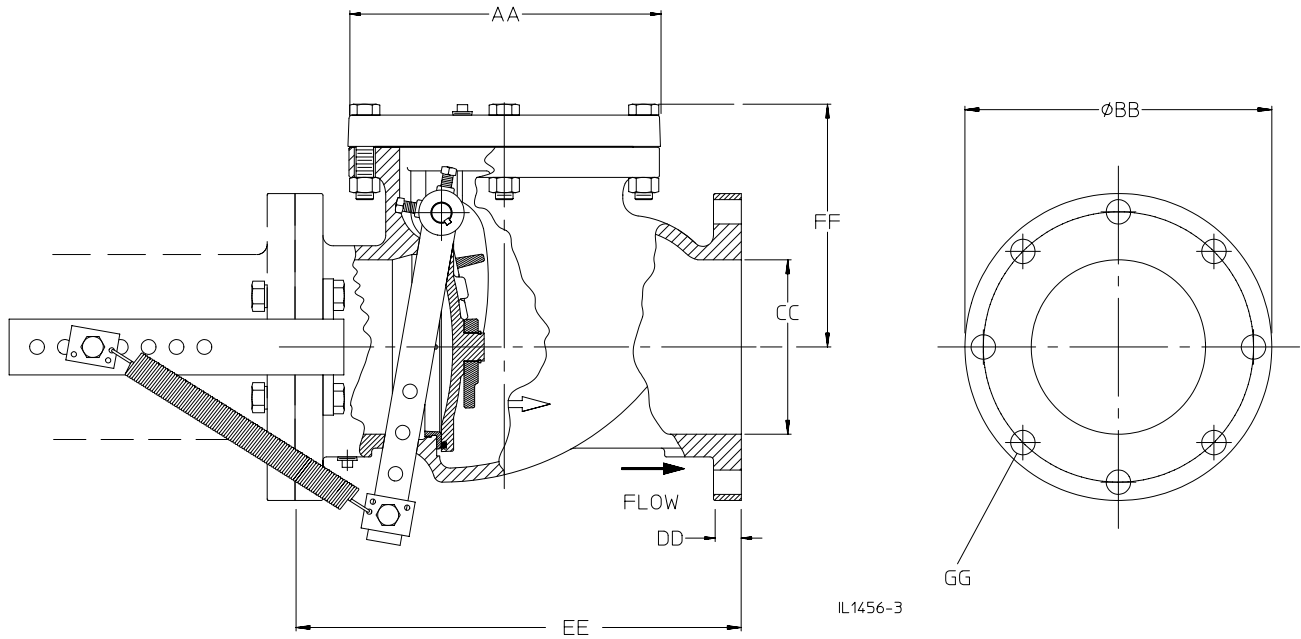

Valve Size	AA	BB	CC	DD	EE	FF	GG		
							Holes	Size	Bolt Circle
3"	8.50	7.50	3.12	0.75	11.00	7.12	4	0.75	6.00
4"	8.38	9.00	4.12	0.94	13.00	6.81	8	0.75	7.50
6"	11.12	11.00	6.25	1.00	16.00	8.50	8	0.88	9.50
8"	14.00	13.50	8.12	1.12	19.50	10.19	8	0.88	11.75
10"	15.25	16.00	10.12	1.19	22.00	12.00	12	1.00	14.25
12"	18.00	19.00	12.12	1.25	26.00	12.38	12	1.00	17.00

SERIES 600 – OPTIONAL TAP LOCATIONS

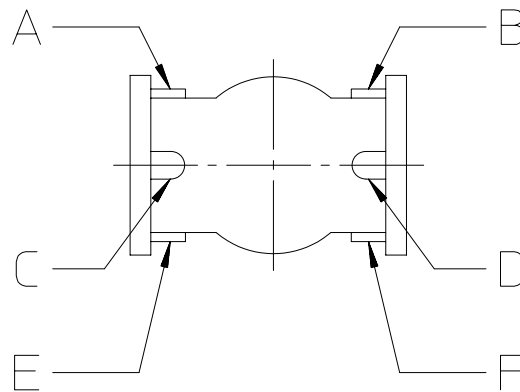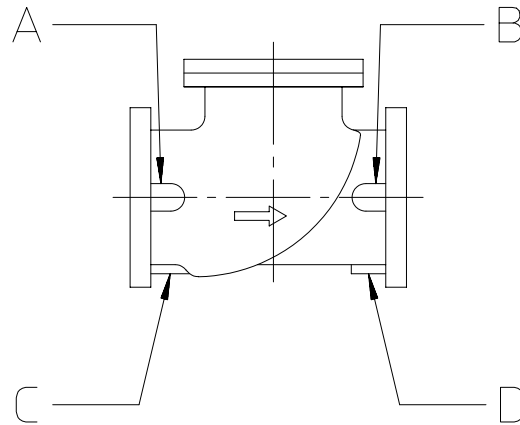

IL1456-1

Valve Size	Maximum Tap Size for Bosses	
	A, B, E & F	C, D
3"	3/4 NPT	3/4 NPT
4"	3/4 NPT	1/2 NPT
6"	1-1/4 NPT	3/4 NPT
8"	1-1/2 NPT	1/2 NPT
10"	2 NPT	3/4 NPT
12"	2 NPT	3/4 NPT



SERIES 600 – WEIGHTS

Valve Size	Standard	Lever / Spring or Weight
3"	60	70
4"	75	85
6"	145	160
8"	245	260
10"	380	405
12"	500	525

NOTE: All weights are in pounds.





SERIES 600 – INSTALLATION AND MAINTENANCE

INSPECTION ON DELIVERY

When shipment arrives, check for shortages, breakage, external damage, etc. Note all such claims on delivery ticket.

Any damage or shortage should be reported immediately to the truck driver, noted on the bill of lading and signed by the driver on your copy.

Carefully unload all valves – **DO NOT DROP.**

STORAGE

Valves are normally palletized when shipped which helps provide protection from weather during storage. If the pallet is disbanded and valves removed, remaining valves should be stored in an upright position with bulkhead flange on top or stored protected from the weather.

INSPECTION

Make sure the valve end flange gasket surfaces are clean and free of damage.

Clean inside of the valve to remove all contaminants that may affect water system purity. Check clapper O-ring or rubber face. Check for free movement of clapper and seal fit.

INSTALLATION

Handle the valve carefully, check cover bolts for tightness. Ensure that the disc swings freely from closed to open and back again.

Be sure that the piping is properly supported to avoid stress on the valve. Make sure that the piping is properly aligned and spaced so the bolting of the valve in the line is not used to correct any errors in piping alignment or spacing.

To reduce check valve slamming, the valves supplied with the optional outside shaft configuration may be equipped with either a lever and weight or a lever and spring option. The principle behind these options is to close the check valve before the fluid establishes a reverse flow. The amount of closing torque required will vary with each system and can be adjusted by changing the number and position of the weights or springs.

Install lever and spring per instruction I-1043 for one spring and I-1044 for two springs. Optional three and four spring kits are available upon request.

The lever and weight arm has two keyways: one for valve waterway horizontal and one for valve waterway vertical.

TESTING

Waterous does not recommend backfilling around buried valves before hydrostatic system test. Leave the valve exposed while the pipeline is being pressure tested (per ANSI/AWWA C600).

Check to see that all valve joints and pressure containing bolts are tight.

After testing relieve excess pressure from upstream side of valve.

MAINTENANCE

Normally there is no maintenance required on the check valve. If the valve begins to operate improperly, it may be necessary to remove the valve cover and inspect the internal disc and arm mechanism.

WARNING

Residual Pressure Hazard. Can result in serious injury.

Shut down the line containing the valve and bleed off residual pressure from the line before attempting to remove the check valve cover.

Remove any debris that may be hung up in the valve and ensure that all moving parts operate freely before reassembling the valve. Repair or replace parts as necessary to return the valve to good working order.

GENERAL NOTES

These reference materials are available and should be helpful in the installation and testing of Swing Check Valves:



- ANSI/AWWA C508 – Swing Check Valves for Waterworks Service.
- ANSI/AWWA C600 – Installation of Ductile Iron Water Mains and Their Appurtenances.

All installation, operation and maintenance instructions are issued by the manufacturer of the pipe and the valves.


- Valve user guide as published by MSS.
- NFPA-24 – Installation of Private Fire Service Mains and Their Appurtenances.

These industry practices have been listed to help you make a safe and acceptable installation of a swing check valve.

SERIES 600 – STANDARD PARTS LIST

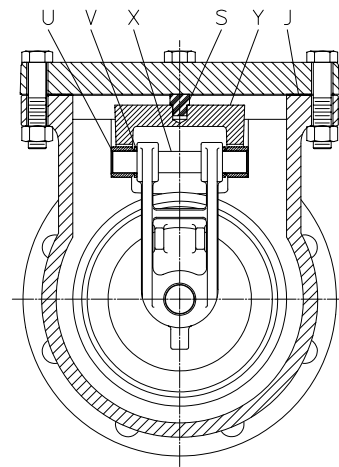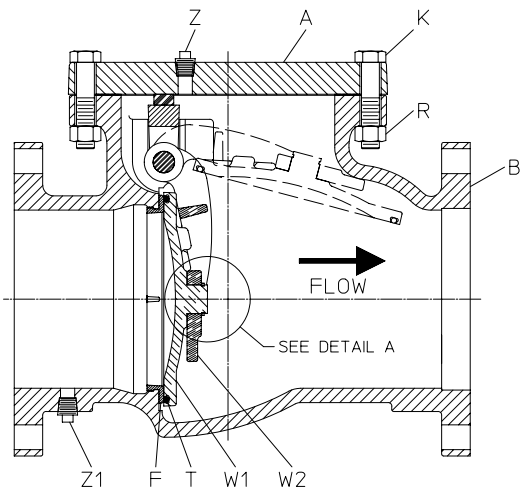

IL1456-4

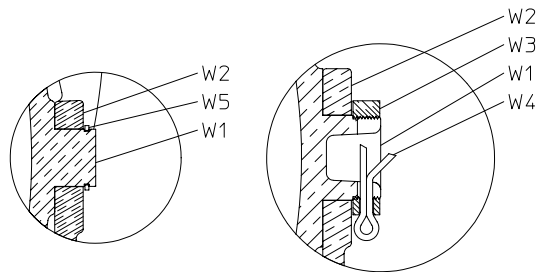

3" THRU 6" SIZES

8" THRU 12" SIZES


DETAIL A

Ref	Description	Material
A	Cover	Gray Iron
B	Valve Body	Gray Iron
F	Body Seat Ring	Bronze
J	Cover Gasket	Synthetic Fiber with Elastomeric Rubber
K	Hex Head Bolt	Zinc Plated Steel
R	Hex Nut	Zinc Plated Steel
S	Bumper	Nitrile Rubber
T	O-ring	Nitrile Rubber
U	Bushing	Brass
V	Shim Washer	Brass
W1	Disc	Manganese Bronze
W2	Arm	Manganese Bronze
W3	Locknut	Manganese Bronze
W4	Cotter Pin	Stainless Steel
W5	Snap Ring	Stainless Steel
X	Shaft	Stainless Steel
Y	Yoke	Gray Iron
Z	Pipe Plug	Galvanized Iron
Z1	Pipe Plug	Brass






SERIES 600 – LEVER AND WEIGHT PARTS LIST

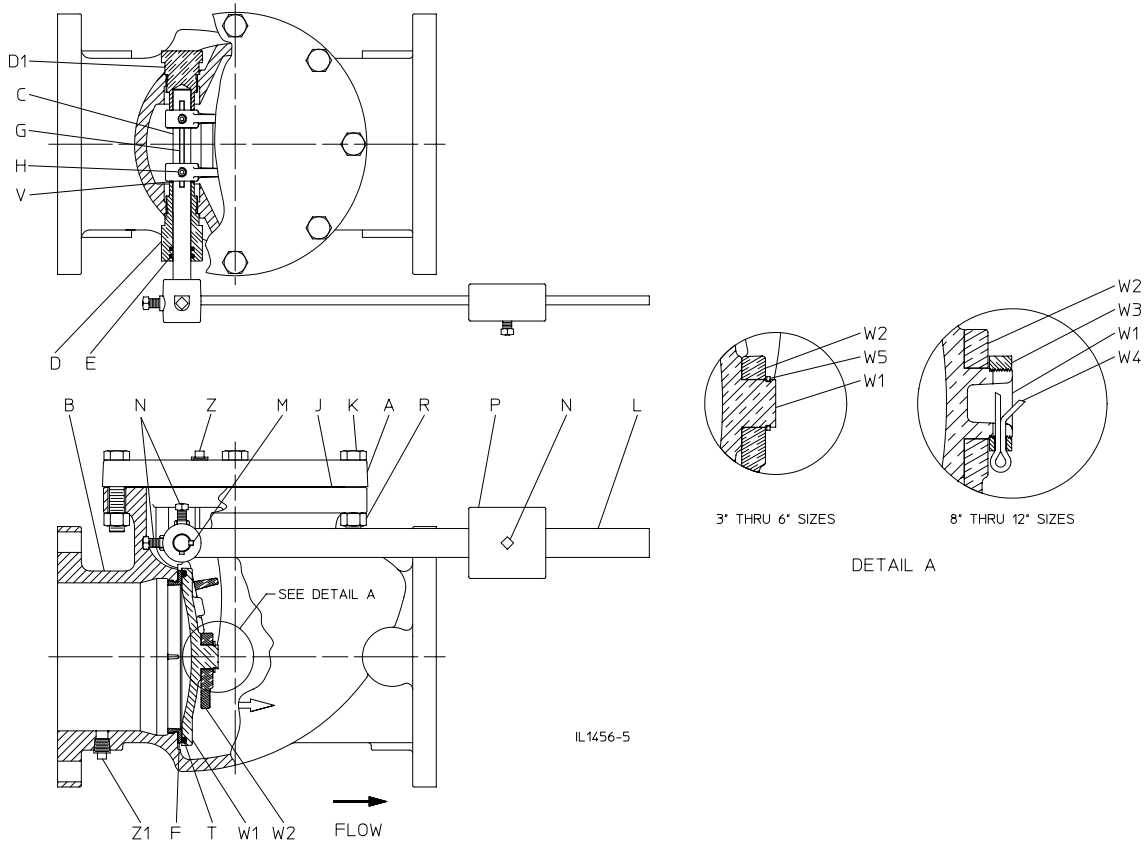

Ref	Description	Material
A	Cover	Gray Iron
B	Valve Body	Gray Iron
C	Shaft	Stainless Steel
D	Shaft Support	Brass
D1	Shaft Retainer	Brass
E	O-ring	Nitrile Rubber
F	Body Seat Ring	Bronze
G	Arm Key	Stainless Steel
H	Socket Head Set Screw	Steel
J	Cover Gasket	Synthetic Fiber with Elastomeric Rubber
K	Hex Head Bolt	Zinc Plated Steel
L	Weight Lever	Manganese Bronze
M	Lever Key	Stainless Steel
N	Square Head Set Screw	Steel
P	Weight	Gray Iron
R	Hex Nut	Zinc Plated Steel
T	O-ring	Nitrile Rubber
V	Shim Washer	Brass
W1	Disc	Manganese Bronze
W2	Arm	Manganese Bronze
W3	Locknut	Manganese Bronze
W4	Cotter Pin	Stainless Steel
W5	Snap Ring	Stainless Steel
Z	Pipe Plug	Galvanized Iron
Z1	Pipe Plug	Brass

SERIES 600 – LEVER AND SPRING PARTS LIST

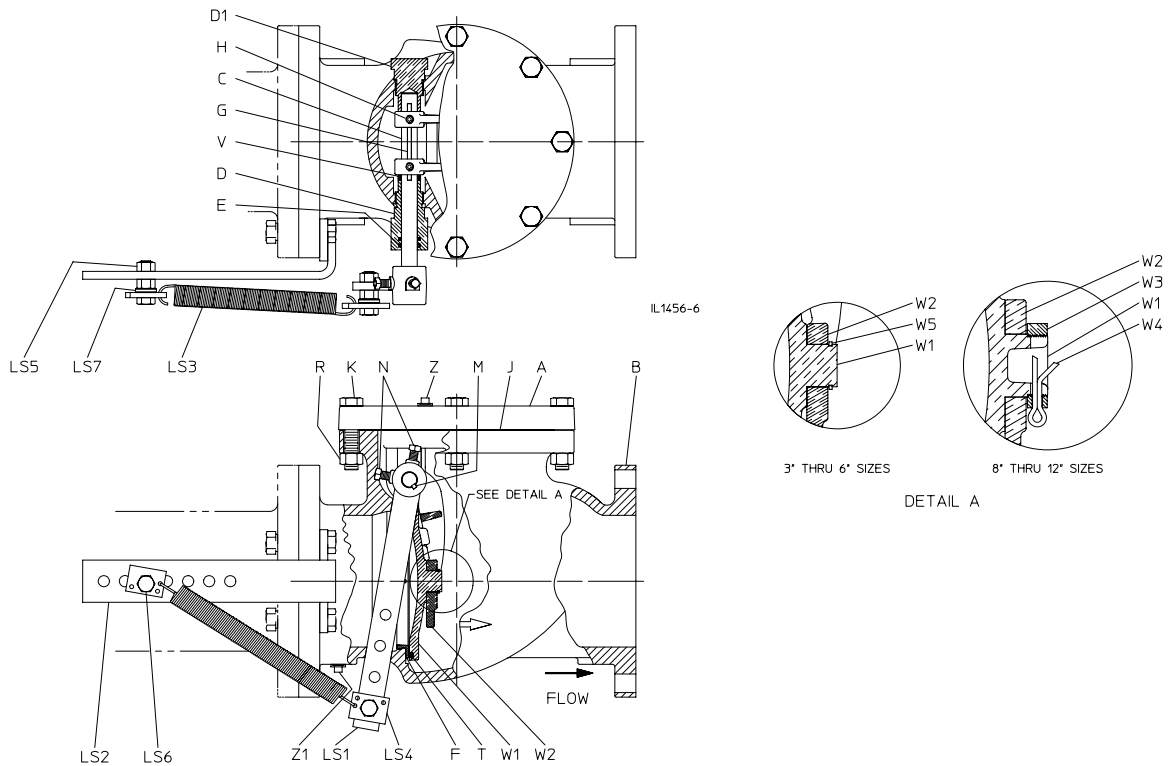

Ref	Description	Material
A	Cover	Gray Iron
B	Valve Body	Gray Iron
C	Shaft	Stainless Steel
D	Shaft Support	Brass
D1	Shaft Retainer	Brass
E	O-ring	Nitrile Rubber
F	Body Seat Ring	Bronze
G	Arm Key	Stainless Steel
H	Socket Head Set Screw	Steel
J	Cover Gasket	Synthetic Fiber with Elastomeric Rubber
K	Hex Head Bolt	Zinc Plated Steel
LS1	Spring Lever	Manganese Bronze
LS2	Bracket	Steel
LS3	Spring	Stainless Steel
LS4	Spring Plate	Steel
LS5	Hex Nut	Zinc Plated Steel
LS6	Hex Head Bolt	Zinc Plated Steel
LS7	Spacer	Steel
R	Hex Nut	Zinc Plated Steel
T	O-ring	Nitrile Rubber
V	Shim Washer	Brass
W1	Disc	Manganese Bronze
W2	Arm	Manganese Bronze
W3	Locknut	Manganese Bronze
W4	Cotter Pin	Stainless Steel
W5	Snap Ring	Stainless Steel
Z	Pipe Plug	Galvanized Iron
Z1	Pipe Plug	Brass

